



ADDENDUM NO. 1

CITY OF PEORIA DEPARTMENT OF PUBLIC WORKS

PUBLIC WORKS FACILITY – NATIVE PLANTINGS, WALKING PATH, AND ACCESSIBLE ENTRANCE

THURSDAY, FEBRUARY 23RD, 2023 @ 10:00 A.M. AT PEORIA PUBLIC WORKS

Addendum Issued: 02/16/2023

RE: **Addendum #1** for the Public Works Facility – Native Plantings, Walking Path, and Accessible Entrance Project

The following shall be considered part of the Contract documents.

REVISED BID DOCUMENTS (Issued with this Addendum):

1) Page #17 - Proposal Bid Form

- a. **Revise** pay item # PEOR0029, “Cobblestone Splashpad” quantity from 6 to 5.
- b. **Revise** pay item # PEOR0030, “Downspout Diffuser” quantity from 4 to 3.
- c. **Revise** pay item # PEOR0035, “Storm Sewer, N-12 Flex (Fine Slot), 8” quantity from 123’ to 102’.

Please use the revised, attached Proposal Bid Form.

2) Plan sheet #C100 – General Notes and Summary of Quantities

- a. **Revise** pay item # PEOR0029, “Cobblestone Splashpad” quantity from 6 to 5.
- b. **Revise** pay item # PEOR0030, “Downspout Diffuser” quantity from 4 to 3.
- c. **Revise** pay item # PEOR0035, “Storm Sewer, N-12 Flex (Fine Slot), 8” quantity from 123’ to 102’.

3) Plan sheet #C320 – “Area C” Storm Sewer and Utility Plan

Remove the farthest northwest downspout diffuser and the cobblestone splashpad. There is no downspout in this location.

4) Plan sheet #C600 – Erosion Control and Storm Sewer Details

Revise the note on the “Trench Backfill Details – Storm Sewer, CASE I” detail that reads, “CONTROLLED LOW STRENGTH MATERIAL (CLSM) PER IDOT STANDARD SPECIFICATIONS” to instead read as follows:

“TRENCH BACKFILL MATERIAL PER SECTION 208 OF IDOT STANDARD SPECIFICATIONS. TRENCH BACKFILL SHALL BE PLACED IN 12" MAX. LIFTS COMPACTED TO 98% STANDARD

CLARIFICATIONS

- 1) Should there be a pay item for the removal of the shrubs, brush, groundcover, aggregate, and misc. debris?

No, per Section 201.01(a) and 201.10(a) the removal and disposal of the shrubs, brush, groundcover, aggregate, misc. debris, or other miscellaneous items not provided for in the pay items shall not be measured for payment.

- 2) Who is removing the cars, trailers, and public works construction materials (inlet frames, lightpoles, etc.)?

The City will remove cars, trailers, and public works construction materials prior to start of work.

- 3) The plans call for “downspout diffusers”. Does the City have a specific manufacturer in mind?

No, if a manufacturer is not found that makes a diffuser that matches the existing diffusers (none known), the downspout diffusers shall be fabricated to match the existing diffusers.

- 4) Can the removed rip-rap be salvaged and reused as “cobblestones” for the splash pads and in the french drain?

No, the removed rip-rap shall not be reused as cobblestones. However, as noted on the plans, the cobblestones that are to be removed may be salvaged and reused for cobblestones.

- 5) Are there specifications or manufacturer of the 30’ flagpole?

See detail on Sheet C710. “FLAGPOLE SHALL BE 30’ TALL, “CONTINENTAL SERIES - ESR” BY CONCORD AMERICAN FLAGPOLE (OR APPROVED EQUAL)”.

- 6) Would we be able to substitute “X” product for “Y” product specified in the plans?

Per “Proposed Product Substitutions” (page 22) of the Contract Documents, “The Total Base Bid Amount [shall] include only those products specified in the Bidding Documents”. The “Proposed Product Substitutions” page does offer the opportunity to propose substitutions with associated add/deduct cost for evaluation. However, only substitutions from the successful bidder will be evaluated and only after the execution of the contract.

- 7) There are no proposed contours for the path of the south end of the site around the salt storage shed. How is this area laid out and graded?

Per the plan notes, the exact alignment (horizontal) shall be FIELD COORDINATED WITH THE ENGINEER. For the vertical alignment, the plans state, “AGGREGATE PATH SHALL MAINTAIN 1.5% CROSSLOPE AND 8.0% MAXIMUM LONGITUDINAL SLOPE.”

This addendum must be acknowledged as part of the submittal package. Failure to do so may subject Bidder to Disqualification.

Sincerely,

Andrea Klopfenstein, P.E.
Deputy Director/City Engineer

PROPOSAL BID FORM

PROPOSAL BID FORM

ARTICLE 1 – BID RECIPIENT

1.01 This Bid is submitted to:

*City of Peoria
Department of Public Works
3505 N. Dries Lane
Peoria, IL 61604*

1.02 The undersigned Bidder proposes and agrees, if this Bid is accepted, to enter into an Agreement with Owner in the form included in these Bidding Documents to perform all Work as specified or indicated in the Bidding Documents for the prices and within the times indicated in this Bid and in accordance with the other terms and conditions of the Bidding Documents.

ARTICLE 2 – BIDDER’S ACKNOWLEDGEMENTS

2.01 Bidder accepts all the terms and conditions of the Instructions to Bidders, including without limitation those dealing with the disposition of Bid security. This Bid will remain subject to acceptance for 60 days after the Bid opening, or for such longer period that Bidder may agree to in writing upon request of Owner.

ARTICLE 3 – BIDDER’S REPRESENTATIONS

3.01 In submitting this Bid, Bidder represents that:

A. Bidder has examined and carefully studied the Bidding Documents, and any data and reference items identified in the Bidding Documents, and hereby acknowledges receipt of the following Addenda:

<u>Addendum No.</u>	<u>Addendum, Date</u>
_____	_____
_____	_____

B. Bidder has visited the Site, conducted a thorough, alert visual examination of the Site and adjacent areas, and become familiar with and satisfied itself as to the general, local, and Site conditions that may affect cost, progress, and performance of the Work.

C. Bidder is familiar with and has satisfied itself as to all Laws and Regulations that may affect cost, progress, and performance of the Work.

D. Bidder has considered the information known to Bidder itself; information commonly known to contractors doing business in the locality of the Site; information and observations obtained from visits to the Site; the Bidding Documents; and any Site-related reports and drawings identified in the Bidding Documents, with respect to the effect of such information, observations, and documents on (1) the cost, progress, and performance of the Work; (2)

PROPOSAL BID FORM

the means, methods, techniques, sequences, and procedures of construction to be employed by Bidder; and (3) Bidder's safety precautions and programs.

- E. Bidder agrees, based on the information and observations referred to in the preceding paragraph, that no further examinations, investigations, explorations, tests, studies, or data are necessary for the determination of this Bid for performance of the Work at the price bid and within the times required, and in accordance with the other terms and conditions of the Bidding Documents.
- F. Bidder is aware of the general nature of work to be performed by Owner and others at the Site that relates to the Work as indicated in the Bidding Documents.
- G. Bidder has given Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Bidder has discovered in the Bidding Documents and confirms that the written resolution thereof by Engineer is acceptable to Bidder.
- H. The Bidding Documents are generally sufficient to indicate and convey understanding of all terms and conditions for the performance and furnishing of the Work.
- I. The submission of this Bid constitutes an incontrovertible representation by Bidder that Bidder has complied with every requirement of this Article, and that without exception the Bid and all prices in the Bid are premised upon performing and furnishing the Work required by the Bidding Documents.

ARTICLE 4 – BIDDER'S CERTIFICATION

4.01 Bidder certifies that:

- A. This Bid is genuine and not made in the interest of or on behalf of any undisclosed individual or entity and is not submitted in conformity with any collusive agreement or rules of any group, association, organization, or corporation;
- B. Bidder has not directly or indirectly induced or solicited any other Bidder to submit a false or sham Bid;
- C. Bidder has not solicited or induced any individual or entity to refrain from bidding; and
- D. Bidder has not engaged in corrupt, fraudulent, collusive, or coercive practices in competing for the Contract. For the purposes of this Paragraph 4.01.D:
 - 1. "corrupt practice" means the offering, giving, receiving, or soliciting of any thing of value likely to influence the action of a public official in the bidding process;
 - 2. "fraudulent practice" means an intentional misrepresentation of facts made (a) to influence the bidding process to the detriment of Owner, (b) to establish bid prices at artificial non-competitive levels, or (c) to deprive Owner of the benefits of free and open competition;
 - 3. "collusive practice" means a scheme or arrangement between two or more Bidders, with or without the knowledge of Owner, a purpose of which is to establish bid prices at artificial, non-competitive levels; and
 - 4. "coercive practice" means harming or threatening to harm, directly or indirectly,

PROPOSAL BID FORM

persons or their property to influence their participation in the bidding process or affect the execution of the Contract.

- E. The undersigned certifies that it is not delinquent in the payment of any indebtedness, tax, fee or fine owed to the City of Peoria, or in the payment of any tax administered by the Illinois Department of Revenue, and is in compliance with the terms and conditions of Sec. 10-109 of the Peoria City Code and 65 ILCS 5/11-42.1-1.
- F. The undersigned firm certifies that it has not been convicted of bribery or attempting to bribe an officer or employee of the City of Peoria, nor has the firm made an admission of guilt of such conduct which is a matter of record, nor has an official, agent, or employee of the firm committed bribery or attempted bribery on behalf of the firm and pursuant to the direction or authorization of a responsible official of the firm. The undersigned firm further certifies that it has not been barred from bidding by the Federal, State or local governments and has not been suspended or debarred from receiving federal funding.
- G. EMPLOYEE/EMPLOYMENT RESTRICTIONS – THE CONTRACTOR, (hereinafter referred to as “SERVICE PROVIDER”) agrees, as a condition of accepting this contract with the City of Peoria, that, for a period of one (1) year following completion of this contract, it shall be prohibited from hiring, directly or indirectly, any City employee or official who was involved, directly or indirectly in: (1) the selection and/or recommendation to select the SERVICE PROVIDER for performance of this contract; (2) coordinating the efforts of the SERVICE PROVIDER in the consummation or completion of this contract; or (3) monitoring or determining the performance of the SERVICE PROVIDER. The SERVICE PROVIDER further acknowledges and agrees that, upon the City’s determination that a violation of this provision has occurred, the penalty imposed, at the sole discretion of the City, may include one or more of the following: (1) cancellation of any other contract(s) between the City of Peoria and the SERVICE PROVIDER; (2) disqualification of the SERVICE PROVIDER from bidding or being awarded future contracts with the City of Peoria for a period of two [2] years; and/or (3) payment of liquidated damages to the City of Peoria in the amount of TWENTY FIVE THOUSAND DOLLARS (\$25,000.00). This provision does not apply to any City employee involved in the 2018-2019 reduction in force, furlough or early retirement incentive offered by the city within 2018-2019. This shall not apply to any city employee involved in the 2020-2021 reduction in force, furlough or early retirement incentive offered by the city within 2020-2021.
- H. Each Bidder must be prequalified with the Illinois Department of Transportation to perform the type of construction work necessary for the project. Bidders shall include a copy of their Illinois Department of Transportation “Certificate of Eligibility” with their bid.
- I. To be awarded a contract all Suppliers, Vendors, Contractors to the City of Peoria, must be registered in the City of Peoria’s Contract Compliance Program and have a current EEO Certification Number. This program is unrelated to any State and Federal program.

The number is secured by submitting to the Equal Opportunity Manager a completed Employer Report Form CC-1, a Fifty-dollar (\$50.00) processing fee and a copy of your company’s sexual harassment policy statement, if you are a first time applicant. Companies renewing their number do not have to submit a copy of their sexual harassment policy

RETURN WITH BID

City of Peoria
 Public Works Facility
 Native Plants, Walking Paths, and Accessible Entrance
PROPOSAL DOCUMENTS

PROPOSAL BID FORM

statement. The form may be obtained from the City’s website at www.peoriagov.org/equal-opportunity/ by clicking on the link. You can also request a copy by e-mail or calling:

Equal Opportunity Manager
ooo@peoriagov.org
 (309) 494-8530

The Fifty-dollar (\$50.00) processing fee can be paid by check, payable to the City of Peoria, or online through the State of Illinois E-Pay process. To pay online go to www.illinoisepay.com and follow the instructions. The only exception to payment of the processing fee is neighborhood associations.

Although all vendors are encouraged to obtain an EEO Certification Number, you do not need a number to respond to a bid. The number is only required prior to the award of a contract.

EEO CERTIFICATION* (Check one):

- We are presently applying for the EEO Certification. Employer Report Form (Form CC-1) is completed and enclosed.
- Presently, we have the Employer Report Form (Form CC-1) on file with the City of Peoria, Office of Equal Opportunity and have a current Certificate of Compliance Number.

Certificate of Compliance Number: _____

ARTICLE 5 – BASIS OF BID

5.01 Base Bid: Bidder will complete the work in accordance with the contract documents for the following price(s):

ITEM NO.	ITEM DESCRIPTION	UNIT	QUANTITY	UNIT PRICE	AMOUNT
20100110	TREE REMOVAL (6-15 UNITS DIAMETER)	UNITS	28	_____	_____
20100210	TREE REMOVAL (OVER 15 UNITS DIAMETER)	UNITS	60	_____	_____
21001000	GEOTECHNICAL FABRIC FOR GROUND STABILIZATION	SQ YD	844	_____	_____
42400800	DETECTABLE WARNINGS	SQ. FT.	248	_____	_____
44000100	PAVEMENT REMOVAL	SQ. YD.	1317	_____	_____
44000500	COMBINATION CURB AND GUTTER REMOVAL	FOOT	617	_____	_____
44000600	SIDEWALK REMOVAL	SQ. FT.	1609	_____	_____
550B0340	STORM SEWER, CLASS B, TYPE 2 (CPE), 12"	FOOT	40	_____	_____
55100200	STORM SEWER REMOVAL, 6"	FOOT	134	_____	_____
60218300	MANHOLES, TYPE A, 4' DIAMETER, TYPE 1 FRAME, OPEN LID	EACH	1	_____	_____

RETURN WITH BID

City of Peoria
Public Works Facility
Native Plants, Walking Paths, and Accessible Entrance
PROPOSAL DOCUMENTS

PROPOSAL BID FORM

60218400	MANHOLES, TYPE A, 4' DIAMETER, TYPE 1 FRAME, CLOSED LID	EACH	1	_____	_____
60236200	INLETS, TYPE A, TYPE 8 GRATE	EACH	2	_____	_____
60603800	COMBINATION CONCRETE CURB AND GUTTER, TYPE B-6.12	FOOT	333	_____	_____
60604400	COMBINATION CONCRETE CURB AND GUTTER, TYPE B-6.18	FOOT	232	_____	_____
67100100	MOBILIZATION	L. SUM	1	_____	_____
78001100	YELLOW PAINT PAVEMENT MARKINGS, LETTERS & SYMBOLS	SQ. FT.	18	_____	_____
78001110	YELLOW PAINT PAVEMENT MARKINGS, 4" LINE	FOOT	452	_____	_____
78001150	WHITE PAINT PAVEMENT MARKINGS, 12" LINE	FOOT	390	_____	_____
PEOR0001	COBBLESTONE REMOVAL AND SALVAGE	SQ. YD.	36	_____	_____
PEOR0002	BOULDER RELOCATION	EACH	2	_____	_____
PEOR0003	COMBINATION CONCRETE CURB / PAVEMENT REMOVAL (SPECIAL)	FOOT	65	_____	_____
PEOR0004	EROSION CONTROL (SPECIAL)	L. SUM	1	_____	_____
PEOR0005	REMOVE AND RELOCATE SIGNS (SPECIAL)	EACH	5	_____	_____
PEOR0006	REMOVE AND SALVAGE SIGNS (SPECIAL)	EACH	4	_____	_____
PEOR0007	CONCRETE BOLLARD W/ ACCESSIBLE SIGN	EACH	4	_____	_____
PEOR0008	IRRIGATION REMOVAL	L. SUM	1	_____	_____
PEOR0009	FLAGPOLE REMOVAL	L. SUM	1	_____	_____
PEOR0010	30' FLAGPOLE	L. SUM	1	_____	_____
PEOR0011	SUBBASE GRANULAR MATERIAL, TYPE B, 4" (SPECIAL)	SQ. FT.	4750	_____	_____
PEOR0012	SUBBASE GRANULAR MATERIAL, TYPE B, 4" (SPECIAL)	SQ. YD.	1472	_____	_____
PEOR0013	SUBBASE GRANULAR MATERIAL, TYPE B, 6" (SPECIAL)	SQ. FT.	348	_____	_____
PEOR0014	APPROACH SLAB AGGREGATE	CU. YD.	7	_____	_____
PEOR0015	P.C.C. COMB. CURB/SIDEWALK, 4" W/ MACRO FIBROUS REINF.	SQ. FT.	669	_____	_____
PEOR0016	P.C.C. SIDEWALK, 4" W/ MACRO FIBROUS REINFORCEMENT (SPECIAL)	SQ. FT.	3885	_____	_____
PEOR0017	P.C.C. SINGLE-RISER STEP W/ MACRO FIBROUS REINFORCEMENT	SQ. FT.	196	_____	_____
PEOR0018	P.C.C. COMB. RAMP/RAISED SIDEWALK-WALL, 6" W/ MACRO FIBROUS REINF.	SQ. FT.	310	_____	_____
PEOR0019	AGGREGATE SURFACE COURSE, 3" (SPECIAL)	SQ. YD.	1472	_____	_____
PEOR0020	P.C.C. STAIRS W/ MACRO FIBROUS REINFORCEMENT	SQ. FT.	38	_____	_____
PEOR0022	P.C.C. PAVEMENT, 8" W/ MACRO FIBROUS REINFORCEMENT	SQ. YD.	844	_____	_____
PEOR0023	AGGREGATE BASE COURSE, 6" (SPECIAL)	SQ. YD.	844	_____	_____

RETURN WITH BID

City of Peoria
Public Works Facility
Native Plants, Walking Paths, and Accessible Entrance
PROPOSAL DOCUMENTS

PROPOSAL BID FORM

PEOR0024	PERMEABLE PAVERS	SQ. YD.	469	_____	_____
PEOR0025	AGGREGATE CHOKER COURSE, 8"	SQ. YD.	574	_____	_____
PEOR0026	AGGREGATE STORAGE COURSE, 30"	SQ. YD.	574	_____	_____
PEOR0027	TRIAxIAL GEOGRID (SPECIAL)	SQ. YD.	1208	_____	_____
PEOR0028	GEOTECHNICAL FABRIC (SPECIAL)	SQ. YD.	574	_____	_____
PEOR0029	COBBLESTONE SPLASHPAD	EACH	5	_____	_____
PEOR0030	DOWNSPOUT DIFFUSER	EACH	3	_____	_____
PEOR0031	FRENCH DRAIN (SPECIAL)	FOOT	176	_____	_____
PEOR0032	STORM SEWER, CLASS B, TYPE 2 (CPE), 6"	FOOT	51	_____	_____
PEOR0033	STORM SEWER, CLASS B, TYPE 2 (CPE, PERF.), 8"	FOOT	272	_____	_____
PEOR0034	STORM SEWER, CLASS B, TYPE 2 (CPE, PERF.), 12"	FOOT	44	_____	_____
PEOR0035	STORM SEWER, N-12 FLEX (FINE SLOT), 8"	FOOT	102	_____	_____
PEOR0036	EARTHWORK, COMPLETE	L. SUM	1	_____	_____
PEOR0037	HOT-MIX ASPHALT FULL DEPTH PATCH	SQ. YD.	4	_____	_____
PEOR0038	NATIVE PERENNIALS AND GRASSES PLANTING, COMPLETE	L. SUM	1	_____	_____
PEOR0039	NATIVE SEEDING AND PLUG PLANTING	SQ. YD.	3389	_____	_____
PEOR0040	NATIVE SEEDING	SQ. YD.	10404	_____	_____
PEOR0041	NATIVE PLANTINGS EXTENDED MAINTENANCE	YEARS	3	_____	_____
X0323569	STEEL POST REMOVAL	EACH	1	_____	_____
X0327727	PLANTER REMOVAL	EACH	1	_____	_____
X1200235	REMOVE EXISTING RIP-RAP	SQ. YD.	269	_____	_____
X5091765	PIPE HANDRAIL (SPECIAL)	FOOT	104	_____	_____
X6061005	P.C.C. CURB, TYPE B (SPECIAL)	FOOT	51	_____	_____
X7010216	TRAFFIC CONTROL AND PROTECTION (SPECIAL)	L. SUM	1	_____	_____
Z0013798	CONSTRUCTION LAYOUT	L. SUM	1	_____	_____

TOTAL BID AMOUNT _____

in writing _____

PROPOSAL BID FORM

ARTICLE 6 – TIME OF COMPLETION

- 6.01 Bidder agrees that the Work will be substantially complete and will be completed and ready for final payment on or before the dates or within the number of calendar days indicated in the Agreement.
- 6.02 Bidder accepts the provisions of the Agreement as to liquidated damages.

ARTICLE 7 – ATTACHMENTS TO THIS BID

- 7.01 The following documents are submitted with and made a condition of this Bid:
- A. Bid Bond
 - B. Subcontractor Utilization Statement
 - C. MBE/WBE Participation Waiver Request (if necessary)
 - D. Qualifications Statement
 - E. Bidders Certification – Document 00454
 - F. Health Safety and Welfare Affidavit – Document 00456

PROPOSAL BID FORM

ARTICLE 8 – BID SUBMITTAL

BIDDER:

By:

[Signature]

[Printed name]

(If Bidder is a corporation, a limited liability company, a partnership, or a joint venture, attach evidence of authority to sign.)

Attest:

[Signature]

[Printed name]

Title:

Submittal Date:

Address for giving notices:

Telephone Number:


Fax Number:

Contact Name and e-mail address:

Bidder's License No.:

(where applicable)


S:\ENGINEERING\PROJECTS\PEORIA CITY OF\20220094 PUBLIC WORKS NATIVE PLANTS AND PATHS\400 CAD\403 PLANS\C320_SS UTIL_PLANDWG 2/16/2023 4:42 PM

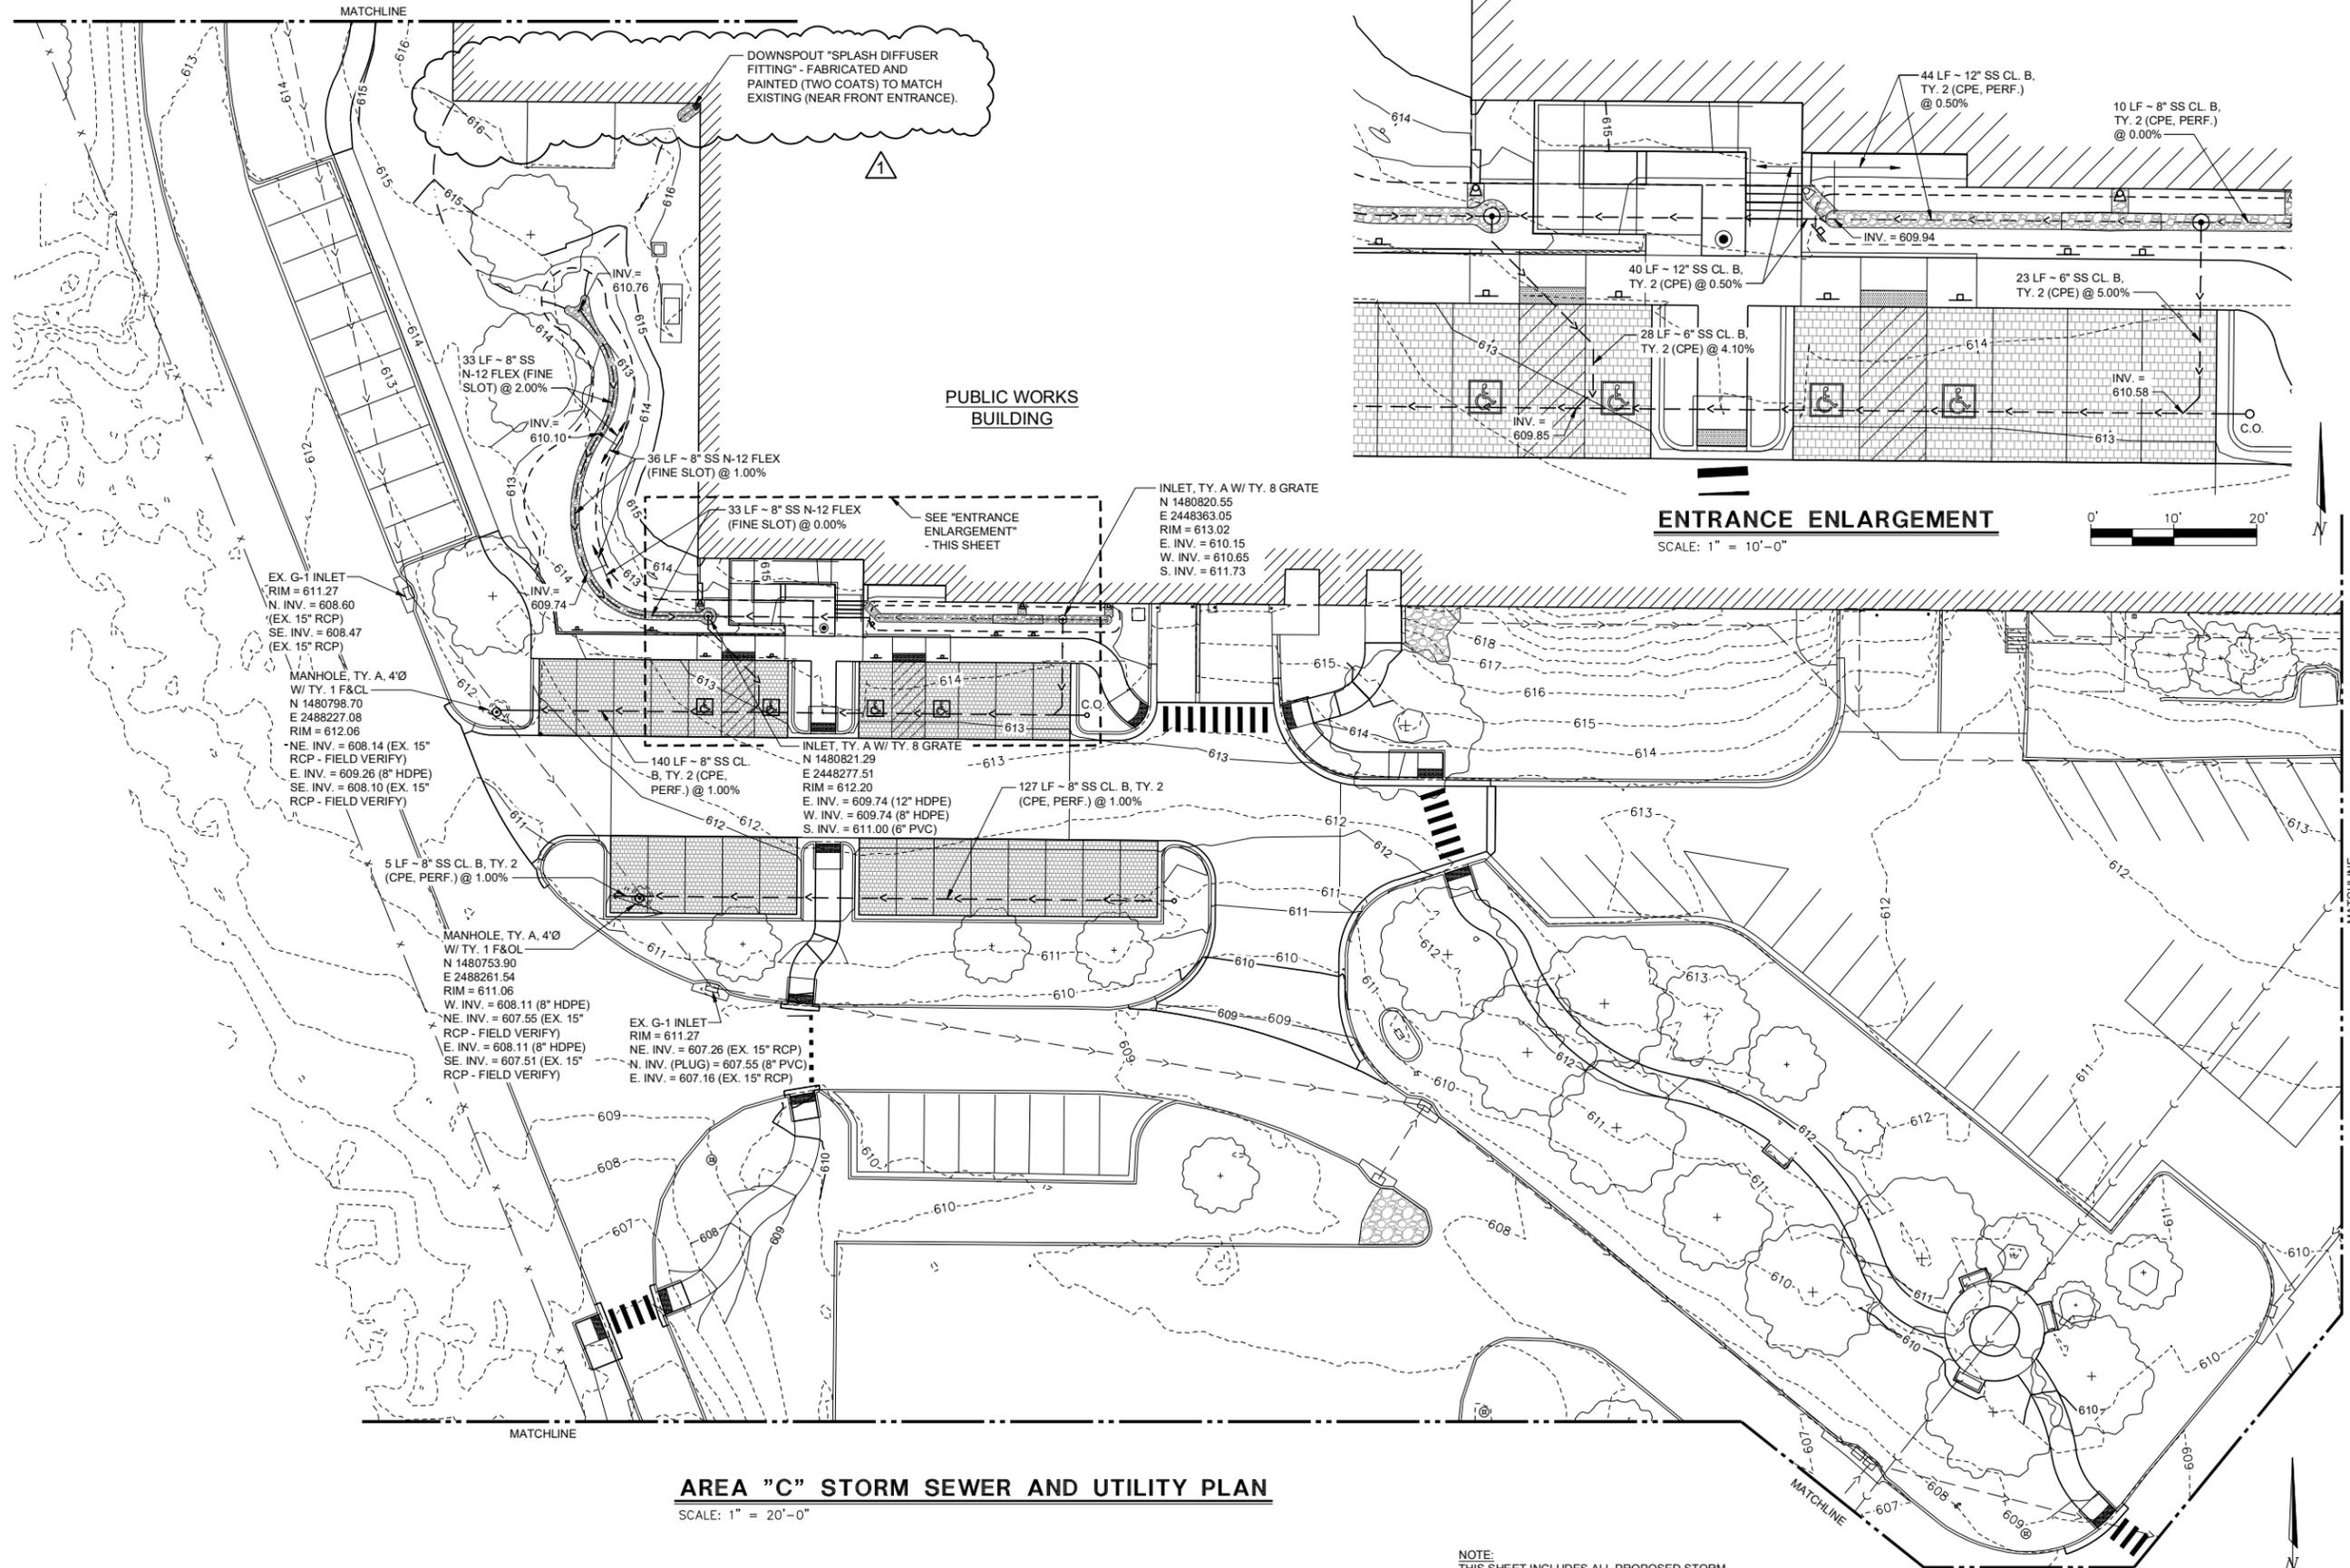

AREA "C" STORM SEWER AND UTILITY PLAN

SCALE: 1" = 20'-0"

NOTE:
THIS SHEET INCLUDES ALL PROPOSED STORM SEWER WORK - THERE ARE NO ADDITIONAL STORM SEWER SHEETS FOR OTHER SITE AREAS.

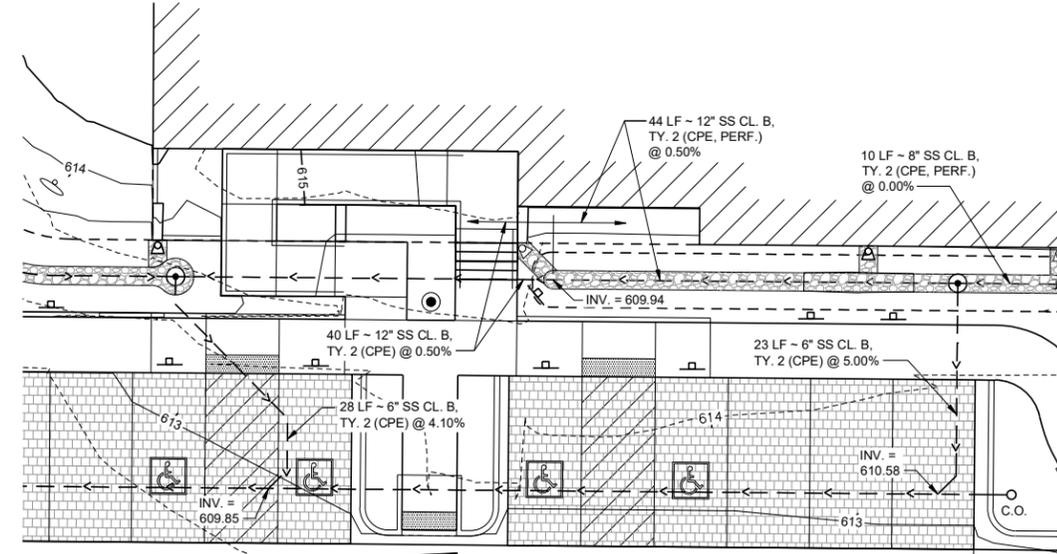

ENTRANCE ENLARGEMENT

SCALE: 1" = 10'-0"



Issued

Rev	Date	Description
1	02/16/2023	ADDENDUM #1

Designed: NHP 02/03/2023
Drawn: NuG 02/03/2023
Checked: NHP 02/03/2023
Approved:

PROJECT NUMBER
20220094

SHEET REFERENCE NUMBER

C320



S:\ENGINEERING\PROJECTS\PEORIA CITY OF 20220094 PUBLIC WORKS NATIVE PLANTS AND PATHS\400 CAD\403 PLANS\CTID_GEN NOTE SUM QUAN.DWG 2/16/2023 4:46 PM

SUMMARY OF QUANTITIES

ITEM#	ITEM DESCRIPTION	* UNIT	BID QUANTITY
20100110	TREE REMOVAL (6-15 UNITS DIAMETER)	UNITS	28
20100210	TREE REMOVAL (OVER 15 UNITS DIAMETER)	UNITS	60
21001000	GEOTECHNICAL FABRIC FOR GROUND STABILIZATION	SQ YD	844
42400800	DETECTABLE WARNINGS	SQ. FT.	248
44000100	PAVEMENT REMOVAL	SQ. YD.	1,317
44000500	COMBINATION CURB AND GUTTER REMOVAL	FOOT	617
44000600	SIDEWALK REMOVAL	SQ. FT.	1,609
550B0340	STORM SEWER, CLASS B, TYPE 2 (CPE), 12"	FOOT	40
55100200	STORM SEWER REMOVAL, 6"	FOOT	134
60218300	MANHOLES, TYPE A, 4' DIAMETER, TYPE 1 FRAME, OPEN LID	EACH	1
60218400	MANHOLES, TYPE A, 4' DIAMETER, TYPE 1 FRAME, CLOSED LID	EACH	1
60236200	INLETS, TYPE A, TYPE 8 GRATE	EACH	2
60603800	COMBINATION CONCRETE CURB AND GUTTER, TYPE B-6.12	FOOT	333
60604400	COMBINATION CONCRETE CURB AND GUTTER, TYPE B-6.18	FOOT	232
67100100	MOBILIZATION	L. SUM	1
78001100	YELLOW PAINT PAVEMENT MARKINGS, LETTERS & SYMBOLS	SQ. FT.	18
78001110	YELLOW PAINT PAVEMENT MARKINGS, 4" LINE	FOOT	452
78001150	WHITE PAINT PAVEMENT MARKINGS, 12" LINE	FOOT	390
PEOR0001	COBBLESTONE REMOVAL AND SALVAGE	SQ. YD.	36
PEOR0002	BOULDER RELOCATION	EACH	2
PEOR0003	COMBINATION CONCRETE CURB / PAVEMENT REMOVAL (SPECIAL)	FOOT	65
PEOR0004	EROSION CONTROL (SPECIAL)	L. SUM	1
PEOR0005	REMOVE AND RELOCATE SIGNS (SPECIAL)	EACH	5
PEOR0006	REMOVE AND SALVAGE SIGNS (SPECIAL)	EACH	4
PEOR0007	CONCRETE BOLLARD W/ ACCESSIBLE SIGN	EACH	4
PEOR0008	IRRIGATION REMOVAL	L. SUM	1
PEOR0009	FLAGPOLE REMOVAL	L. SUM	1
PEOR0010	30' FLAGPOLE	L. SUM	1
PEOR0011	SUBBASE GRANULAR MATERIAL, TYPE B, 4" (SPECIAL)	SQ. FT.	4,750
PEOR0012	SUBBASE GRANULAR MATERIAL, TYPE B, 4" (SPECIAL)	SQ. YD.	1,472
PEOR0013	SUBBASE GRANULAR MATERIAL, TYPE B, 6" (SPECIAL)	SQ. FT.	348
PEOR0014	APPROACH SLAB AGGREGATE	CU. YD.	7
PEOR0015	P.C.C. COMBINATION CURB/SIDEWALK, 4" W/ MACRO FIBROUS REINFORCEMENT	SQ. FT.	669
PEOR0016	P.C.C. SIDEWALK, 4" W/ MACRO FIBROUS REINFORCEMENT (SPECIAL)	SQ. FT.	3,885
PEOR0017	P.C.C. SINGLE-RISER STEP W/ MACRO FIBROUS REINFORCEMENT	SQ. FT.	196
PEOR0018	P.C.C. COMBINATION RAMP/RAISED SIDEWALK-WALL, 6" W/ MACRO FIBROUS REINFORCEMENT	SQ. FT.	310
PEOR0019	AGGREGATE SURFACE COURSE, 3" (SPECIAL)	SQ. YD.	1,472
PEOR0020	P.C.C. STAIRS W/ MACRO FIBROUS REINFORCEMENT	SQ. FT.	38
PEOR0022	P.C.C. PAVEMENT, 8" W/ MACRO FIBROUS REINFORCEMENT	SQ. YD.	844
PEOR0023	AGGREGATE BASE COURSE, TYPE B, 6" (SPECIAL)	SQ. YD.	844
PEOR0024	PERMEABLE PAVERS	SQ. FT.	469
PEOR0025	AGGREGATE CHOKER COURSE, 8"	SQ. YD.	574
PEOR0026	AGGREGATE STORAGE COURSE, 30"	SQ. YD.	574
PEOR0027	TRIAxIAL GEOGRID (SPECIAL)	SQ. YD.	1,208
PEOR0028	GEOTECHNICAL FABRIC (SPECIAL)	SQ. YD.	574
PEOR0029	COBBLESTONE SPLASHPAD	EACH	5
PEOR0030	DOWNSPOUT DIFFUSER	EACH	3
PEOR0031	FRENCH DRAIN (SPECIAL)	FOOT	176
PEOR0032	STORM SEWER, CLASS B, TYPE 2 (CPE), 6"	FOOT	51
PEOR0033	STORM SEWER, CLASS B, TYPE 2 (CPE, PERF.), 8"	FOOT	272
PEOR0034	STORM SEWER, CLASS B, TYPE 2 (CPE, PERF.), 12"	FOOT	44
PEOR0035	STORM SEWER, N-12 FLEX (FINE SLOT), 8"	FOOT	102
PEOR0036	EARTHWORK, COMPLETE	L. SUM	1
PEOR0037	HOT-MIX ASPHALT FULL DEPTH PATCH	SQ. YD.	4
PEOR0038	NATIVE PERENNIALS AND GRASSES PLANTING, COMPLETE	L. SUM	1
PEOR0039	NATIVE SEEDING AND PLUG PLANTING	SQ. YD.	3,389
PEOR0040	NATIVE SEEDING	SQ. YD.	10,404
PEOR0041	NATIVE PLANTINGS EXTENDED MAINTENANCE	YEARS	3
X0323569	STEEL POST REMOVAL	EACH	1
X0327727	PLANTER REMOVAL	EACH	1
X1200235	REMOVE EXISTING RIP-RAP	SQ. YD.	269
X5091765	PIPE HANDRAIL (SPECIAL)	FOOT	104
X6061005	P.C.C. CURB, TYPE B (SPECIAL)	FOOT	51
X7010216	TRAFFIC CONTROL AND PROTECTION (SPECIAL)	L. SUM	1
Z0013798	CONSTRUCTION LAYOUT	L. SUM	1

* METHOD OF MEASUREMENT FOR AREAS: THE AREA(S) ARE BASED ON PLAN AREA(S) AS HORIZONTALLY MEASURED ELECTRONICALLY IN AUTOCAD. NO INCREASE IN THE AREA(S) WILL BE MADE DUE TO THE ROLLING/SLOPING TERRAIN (CHANGES IN THE TOPOGRAPHY'S ELEVATIONS).

GENERAL NOTES

1. THE TERM OWNER AND CITY AS REFERENCED THROUGHOUT THE PLANS AND SPECIFICATIONS/SPECIAL PROVISIONS IS DEFINED AS THE CITY ENGINEER OF THE CITY OF PEORIA.
2. ALL WORK MUST BE FULLY COORDINATED WITH OWNER OVER THE CONSTRUCTION PERIOD. A "STAGING PLAN" WILL BE DEVELOPED BY CONTRACTOR COOPERATIVELY BETWEEN OWNER AND CONTRACTOR PRIOR TO BEGINNING WITH CONSTRUCTION.
3. ALL SECTIONS, DETAILS, AND NOTES SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL APPLY TO SIMILAR SITUATIONS ELSEWHERE, UNLESS OTHERWISE SHOWN.
4. ADJUSTMENT OF PROPOSED GRADES TO MATCH EXISTING FIELD CONDITIONS MAY BE REQUIRED AS DIRECTED BY OWNER.
5. CONTRACTOR SHALL NOTIFY OWNER IN WRITING A MINIMUM OF ONE WEEK (7 CALENDAR DAYS) IN ADVANCE OF ANY CONSTRUCTION ACTIVITIES THAT MAY INTERFERE WITH THE OWNER'S DAILY OPERATIONS. CONTRACTOR SHALL RECEIVE APPROVAL FROM OWNER PRIOR TO COMMENCING WITH ANY CONSTRUCTION ACTIVITIES THAT MAY INTERFERE WITH DAILY OPERATIONS OF THE FACILITY.
6. CONTRACTOR PARKING SHALL BE COORDINATED WITH CITY OF PEORIA.
7. TESTING OF EARTHEN MATERIALS, BACKFILL, AND GRANULAR MATERIALS TO BE COMPLETED BY CITY ENGINEER.

LIST OF IDOT STANDARDS

HIGHWAY STANDARDS	
000001-08	STANDARD SYMBOLS, ABBREVIATIONS AND PATTERNS
001001-02	AREAS OF REINFORCEMENT BARS
001006	DECIMAL OF AN INCH AND OF A FOOT
280001-07	TEMPORARY EROSION CONTROL SYSTEMS
424001-11	PERPENDICULAR CURB RAMP
424006-05	DIAGONAL CURB RAMP
424011-04	CORNER PARALLEL CURB RAMP
424016-05	MID-BLOCK CURB RAMP
602301-04	INLET, TYPE A
602401-07	PRECAST MANHOLE, TYPE A, 4' DIAMETER
604001-05	FRAME AND LIDS, TYPE 1
604036-03	GRATE TYPE 8
606001-08	CONCRETE CURB, TYPE B AND COMBINATION CONCRETE CURB AND GUTTER
701901-08	TRAFFIC CONTROL DEVICES
720001-01	SIGN PANEL MOUNTING DETAILS
720006-04	SIGN PANEL ERECTION DETAILS
728001-01	TELESCOPING STEEL SIGN SUPPORT

CITY OF PEORIA CONTACT INFORMATION

PAOLA MENDEZ-SILVAGNOLI, P.E. - ASSISTANT CITY ENGINEER
 CITY OF PEORIA DEPT. OF PUBLIC WORKS - ENGINEERING DIVISION
 3505 N. DRIES LANE, PEORIA, IL 61604
 (309) 494-8811

CONSTRUCTION SCHEDULE

CONTRACTOR WILL DEVELOP AND EXECUTE TO THE BEST OF HIS/HER ABILITY A CONSTRUCTION SCHEDULE THAT MINIMIZES THE TIMEFRAME IN WHICH THE FRONT ENTRANCE IS INACCESSIBLE. CONTRACTOR SHALL COORDINATE WITH THE CITY ALTERNATE BUILDING ACCESS ROUTE(S) FOR CITY STAFF AND VISITORS AND SHALL MAINTAIN ALTERNATE ROUTE(S) FOR THE DURATION OF CONSTRUCTION. THE CITY EXPECTS CONTRACTOR TO COMPLETE REMOVABLE AND REPLACEMENT OF THE FRONT ENTRANCE SIDEWALKS AND WALKWAYS WITH DAILY MEASURABLE PROGRESS. CITY UNDERSTANDS THERE ARE STANDARD/TYPICAL DELAYS ASSOCIATED WITH PROJECTS OF THIS SCOPE, BUT DELAY TIMEFRAMES SHOULD BE MINIMIZED AS MUCH AS POSSIBLE.



140 E. Washington Street
 East Peoria, Illinois 61611
 309.222.8600
 www.mweainc.com

IL Design Firm Reg. No.
 184-005896

GENERAL NOTES AND SUMMARY OF QUANTITIES

CITY OF PEORIA
 DEPARTMENT OF PUBLIC WORKS
 PUBLIC WORKS FACILITY
 NATIVE PLANTS, WALKING PATH,
 AND ACCESSIBLE ENTRANCE

Issued

Rev	Date	Description

1 02/16/2023
 ADDENDUM #1

Designed: NHP 02/03/2023

Drawn: NuG 02/03/2023

Checked: NHP 02/03/2023

Approved:

PROJECT NUMBER



20220094

SHEET REFERENCE NUMBER

C100



NOTES:

- MINIMUM ALLOWABLE TRENCH WIDTH WHEN DEPTH IS < 5': $W = 9" + D + 9"$
- ANY SOFT (IBV < 4.0) OR SPONGY MATERIAL ENCOUNTERED BELOW THE ELEVATION OF THE PIPE SHALL BE REMOVED AND REPLACED WITH WELL COMPACTED MOIST FINE AGGREGATE (FA-6) OR MOIST COARSE AGGREGATE (CA-6 CRUSHED LIMESTONE). THE REMOVAL AND REPLACEMENT OF SOFT/SPONGE MATERIAL AND TYPE OF AGGREGATE TO BE USED SHALL BE APPROVED BY OWNER IN WRITING.
- CASE I APPLIES TO ALL TRENCHES WHERE THE TRENCH'S INNER EDGE OF THE BENCH IS WITHIN 2.0 FEET OF EXISTING/PROPOSED: EDGE OF PAVEMENT, CURB, GUTTER, CURB AND GUTTER, STABILIZED SHOULDER, AND SIDEWALK. CASE I ALSO APPLIES TO ALL TRENCHES UNDER/WITHIN EXISTING/PROPOSED: PAVEMENT, CURB, GUTTER, CURB AND GUTTER, STABILIZED SHOULDER, SLABS OR SIDEWALK, ETC.
- CASE II APPLIES AT UTILITY CROSSINGS. EXTENT OF CONTROLLED LOW STRENGTH MATERIAL BACKFILL SHALL BE EQUAL TO THE TRENCH WIDTHS FOR EACH RESPECTIVE UTILITY LEADING UP TO THE CROSSING. FOR INSTANCE, IF UTILITY #1 HAS A 3' TRENCH AND IS CROSSING UTILITY #2 WITH A 5' TRENCH, EXTENTS OF CLSM BACKFILL SHALL MEASURE 3'X5'.
- SATISFACTORY SOILS/SELECT EXCAVATED MATERIAL IS DEFINED AS MATERIAL CLASSIFIED AS EITHER GW, GM, GC, SW, SC, ML OR CL IN ACCORDANCE WITH THE UNIFIED SOIL CLASSIFICATION SYSTEM AND HAS AN IN PLACE MOISTURE CONTENT BETWEEN 90% AND 110% OF THE MATERIALS OPTIMUM MOISTURE CONTENT AS DETERMINED BY THE STANDARD PROCTOR TEST (ASTM D698).
- THE TRENCH BACKFILL DETAILS ABOVE ARE NOT APPLICABLE FOR STORM SEWER PIPE WITHIN THE FRENCH DRAIN OR WITHIN THE AGGREGATE STORAGE AREA OF THE PERMEABLE PAVERS.

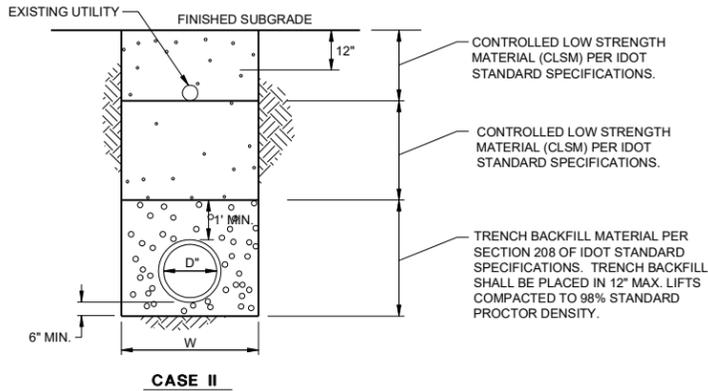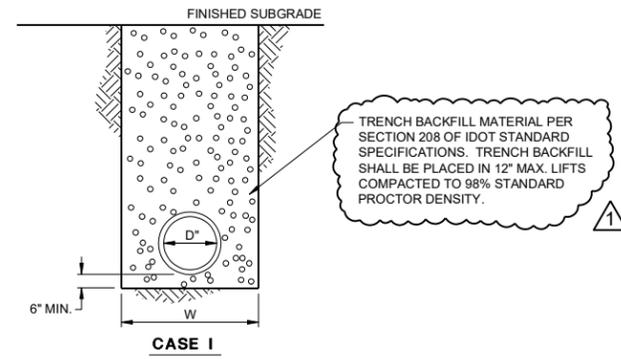


TRENCH BACKFILL DETAILS - STORM SEWER

SCALE: N.T.S.

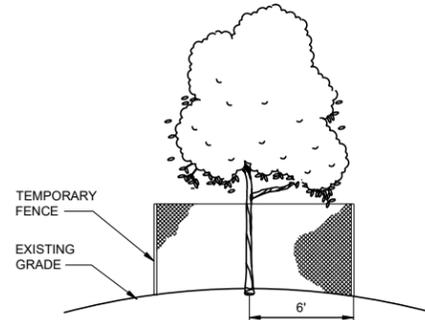


TREE PROTECTION

SCALE: N.T.S.

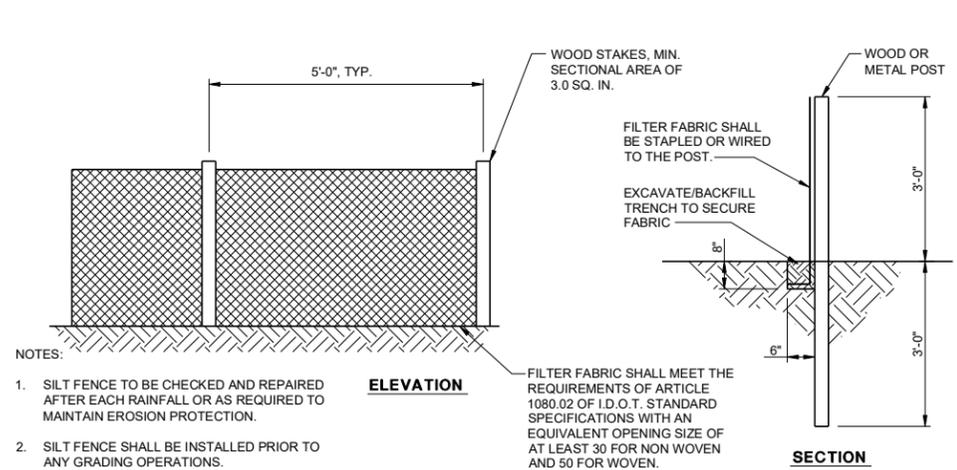


PERIMETER EROSION BARRIER - SILT FENCE DETAIL

SCALE: N.T.S.

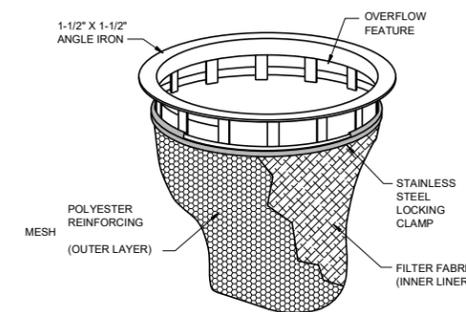


INLET FILTER PROTECTION

SCALE: N.T.S.

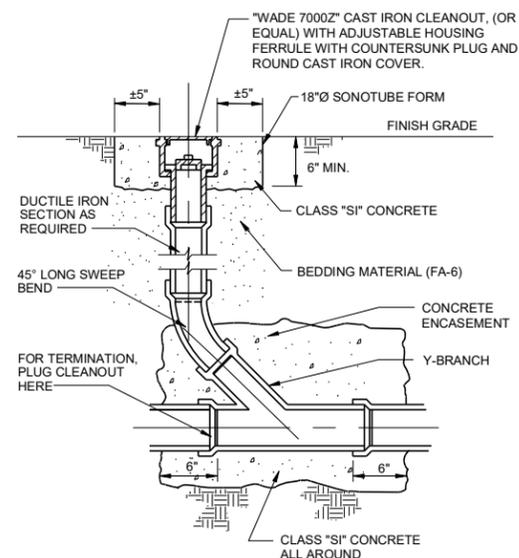


CLEANOUT

SCALE: N.T.S.

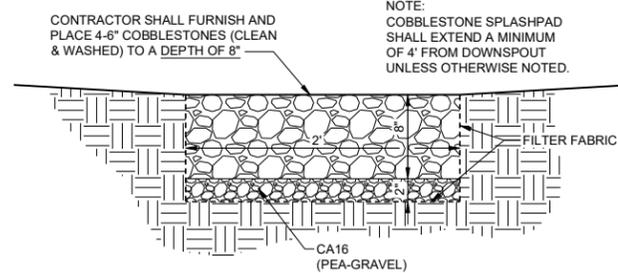


COBBLESTONE SPLASHPAD

SCALE: N.T.S.

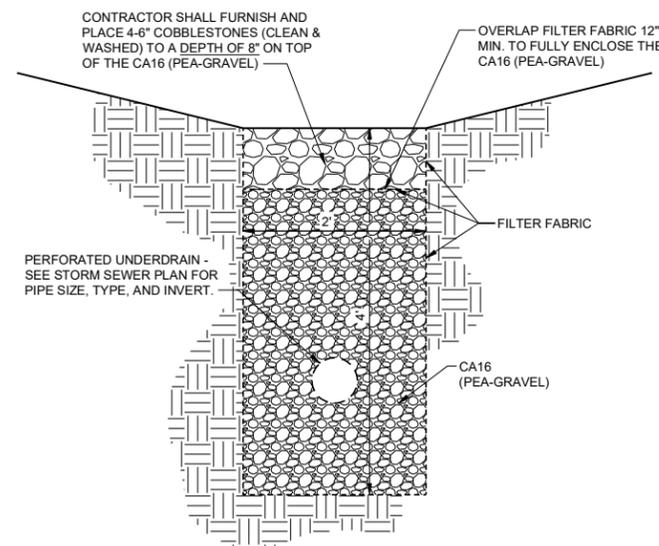

FRENCH DRAIN

SCALE: N.T.S.

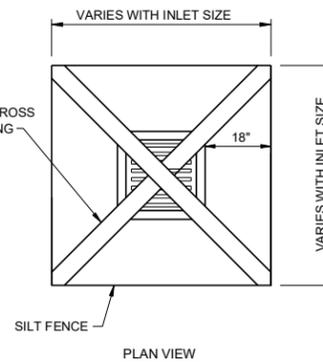

INLET FILTER PROTECTION - SILT FENCE PLAN

SCALE: N.T.S.

INLET FILTER NOTES:

- INLET FILTERS SHALL BE INSTALLED EITHER DIRECTLY ON THE DRAINAGE STRUCTURE OR UNDER THE GRATE OF THE DRAINAGE STRUCTURE RESTING ON THE LIP OF THE FRAME. THE FABRIC BAG SHALL HANG DOWN INTO THE DRAINAGE STRUCTURE. PRIOR TO ORDERING MATERIALS, THE CONTRACTOR SHALL DETERMINE THE SIZE AND SHAPE OF THE VARIOUS DRAINAGE STRUCTURES BEING PROTECTED.
- AN INLET FILTER SHALL CONSIST OF A STEEL FRAME WITH A TWO PIECE GEOTEXTILE FABRIC BAG ATTACHED WITH A STAINLESS STEEL BAND AND LOCKING CLAMP THAT IS SUSPENDED FROM THE FRAME. A CLEAN, USED BAG AND A USED STEEL FRAME IN GOOD CONDITION MEETING THE APPROVAL OF THE ENGINEER MAY BE SUBSTITUTED FOR NEW MATERIALS.

NOTES:

- SEDIMENT SHALL BE REMOVED AND THE TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH. REMOVED SEDIMENT SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
- THE SEDIMENT TRAP SHALL BE REMOVED AND THE AREA STABILIZED WHEN THE CONSTRUCTED DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.
- INLET PROTECTION SHALL BE PROVIDED AROUND ALL TYPES OF INLETS IN NON-PAVED AREAS AND FLARED END SECTIONS IDENTIFIED.

S:\ENGINEERING\PROJECTS\PEORIA CITY OF 20220094 PUBLIC WORKS NATIVE PLANTS AND PATHS\00 CAD\403 PLANS\0600_LEC.DWG 2/16/2023 4:49 PM

Issued

Rev Date Description

1 02/16/2023
ADDENDUM #1

Designed: NHP 02/03/2023

Drawn: NuG 02/03/2023

Checked: NHP 02/03/2023

Approved:

PROJECT NUMBER

20220094

SHEET REFERENCE NUMBER

C600